


Customer:

Woolly Shepherd

Construction tested

Clouds

Frequency Hz	Absorption $A_{obj}m^2$
100	0.22
125	0.28
160	0.42
200	0.44
250	0.73
315	1.01
400	1.18
500	1.34
630	1.43
800	1.50
1000	1.50
1250	1.52
1600	1.49
2000	1.46
2500	1.43
3150	1.42
4000	1.36
5000	1.29

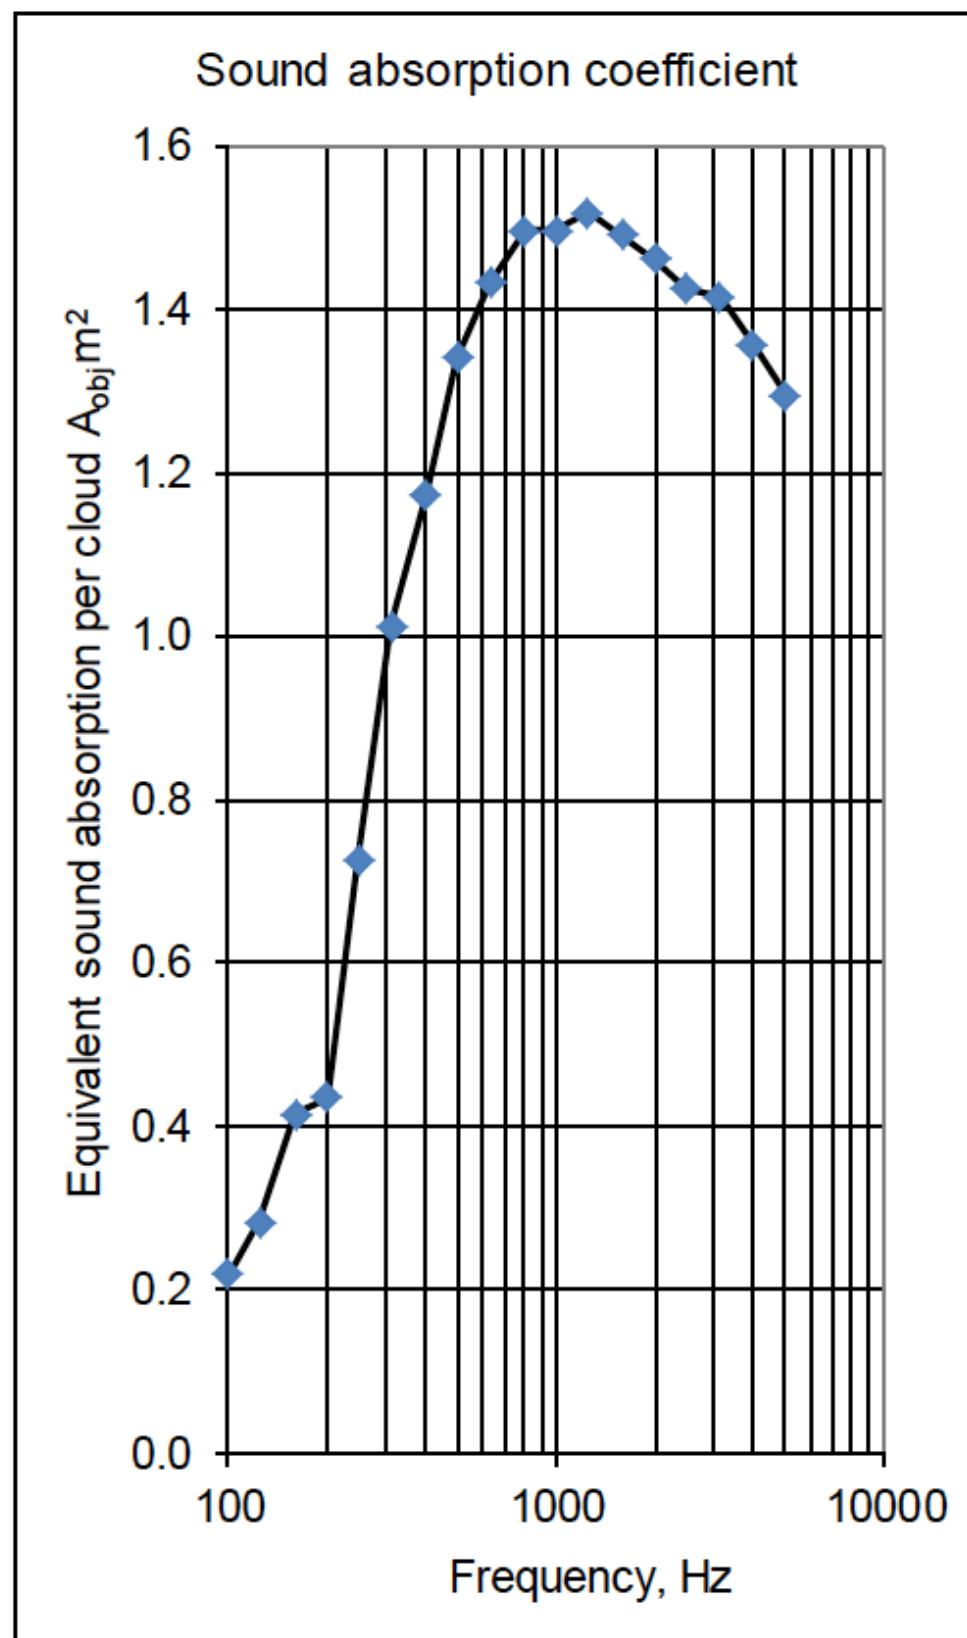

Test Standard: BS EN ISO 354

UNIVERSITY OF
Southampton
ISVR Consulting

Project No: 9383

University of Southampton
Highfield, Southampton

Tested by:
Test date:

J.Fithyan
27/01/2015