


Customer:

Woolly Shepherd

Construction tested

Suspended Circles

Frequency Hz	Absorption $A_{obj}m^2$
100	0.15
125	0.13
160	0.17
200	0.29
250	0.43
315	0.58
400	0.68
500	0.84
630	0.88
800	0.92
1000	0.93
1250	0.93
1600	0.89
2000	0.89
2500	0.88
3150	0.87
4000	0.84
5000	0.80

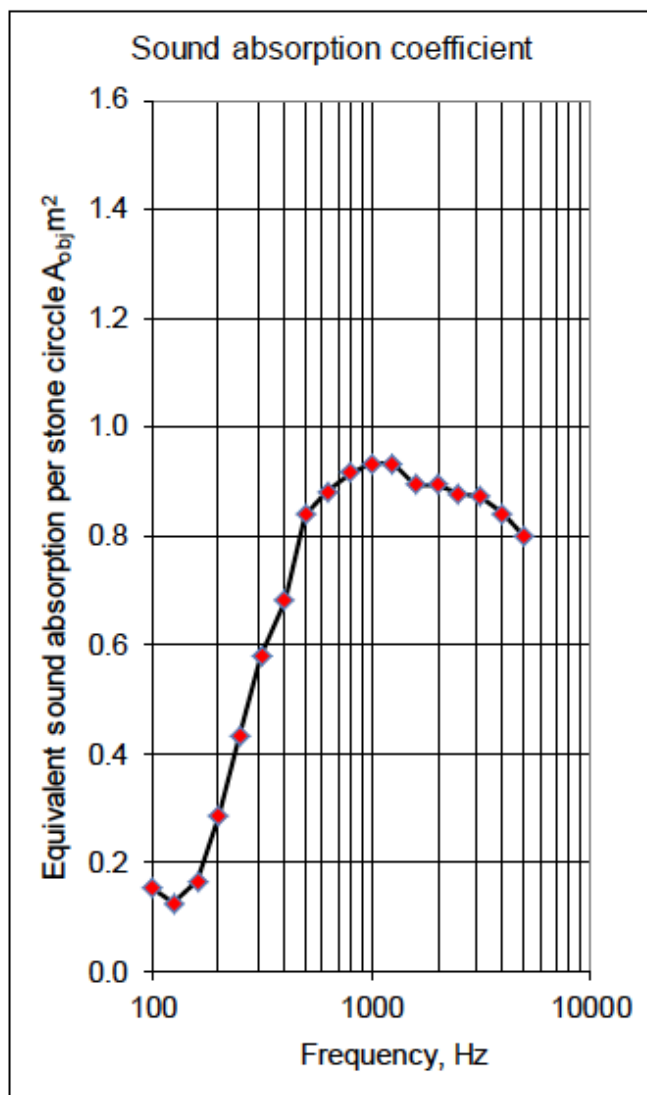

Test Standard: BS EN ISO 354

UNIVERSITY OF
Southampton

ISVR Consulting

Project No: 10232

University of Southampton
Highfield, Southampton

Tested by: J.Fithyan
Test date: 15/11/2017