


Airborne sound absorption measured in a reverberation chamber.
BS EN ISO 354:2003

Customer: Woolly Shepherd

Construction tested

Ellipses

Frequency Hz	Absorption $A_{obj} m^2$
100	0.20
125	0.20
160	0.35
200	0.49
250	0.67
315	0.91
400	1.11
500	1.31
630	1.39
800	1.47
1000	1.43
1250	1.38
1600	1.40
2000	1.39
2500	1.40
3150	1.39
4000	1.41
5000	1.38

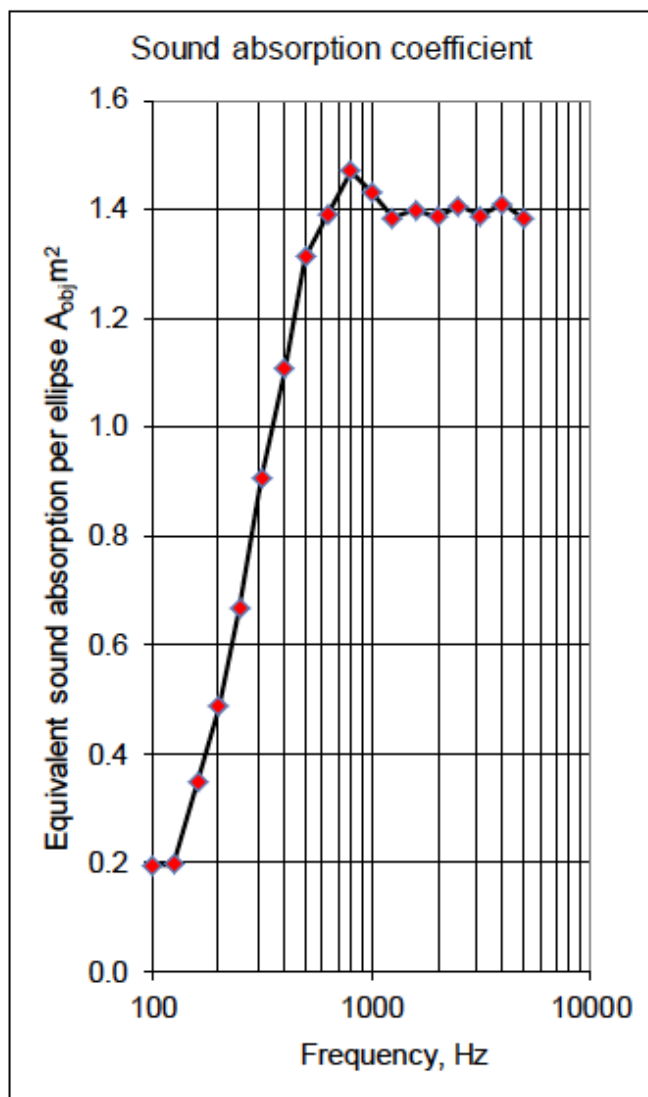

Test Standard: BS EN ISO 354

UNIVERSITY OF
Southampton
ISVR Consulting

Project No: 9905

University of Southampton
Highfield, Southampton

Tested by: J.Fithyan
Test date: 15/12/2016